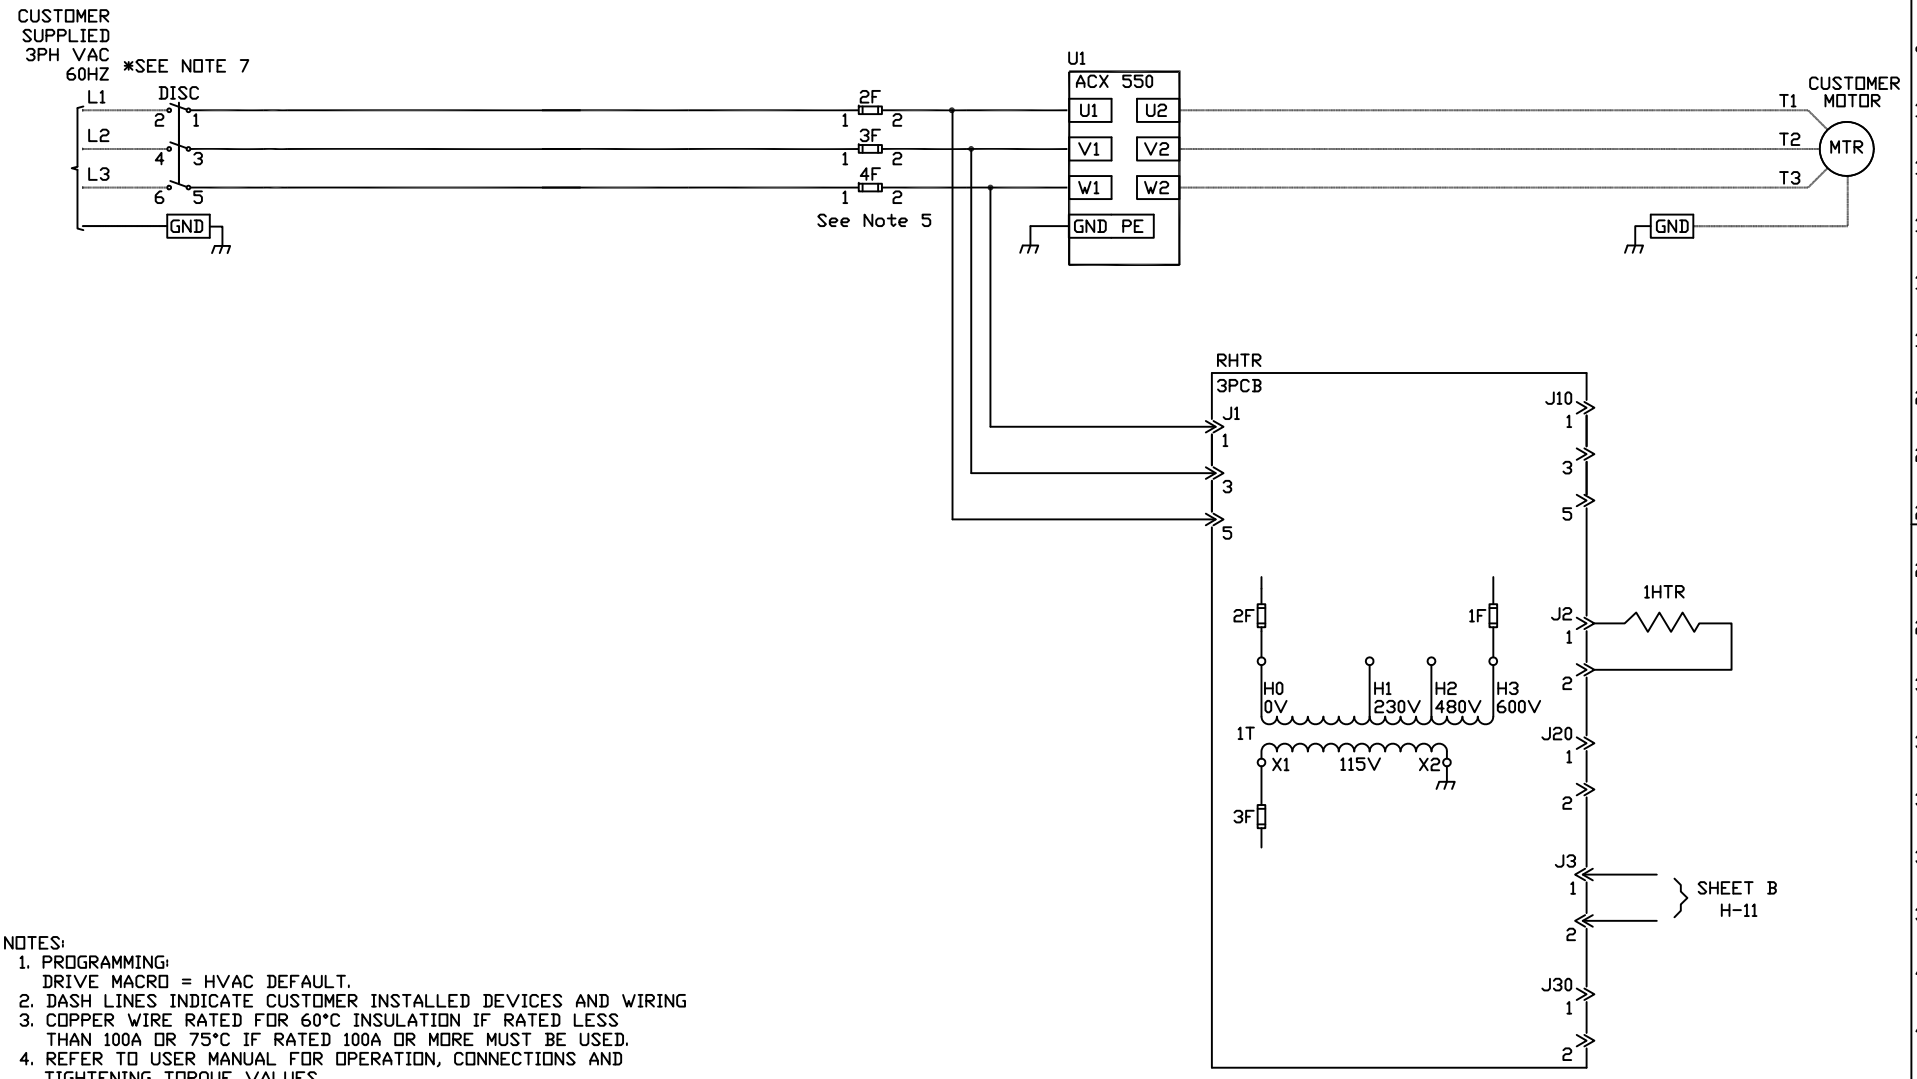

NOTES:

1. PROGRAMMING:
   DRIVE MACRO = HVAC DEFAULT.
2. DASH LINES INDICATE CUSTOMER INSTALLED DEVICES AND WIRING
3. COPPER WIRE RATED FOR 60°C INSULATION IF RATED LESS THAN 100A OR 75°C IF RATED 100A OR MORE MUST BE USED.
4. REFER TO USER MANUAL FOR OPERATION, CONNECTIONS AND TIGHTENING TORQUE VALUES.
5. FUSE RATING LABEL IS NEAR DEVICE.
6. CUSTOMER REQUIRED TO PROVIDE BRANCH CIRCUIT PROTECTION AND DISCONNECT MEANS PER NEC AND LOCAL CODE.
7. SHORT CIRCUIT CURRENT: 5kA RMS SYMMETRICAL 600V MAXIMUM.
8. TRANSFORMER 1T IS WIRED FOR APPROPRIATE PRIMARY VOLTAGE.

We reserve all rights in this document and the information contained therein. Reproduction, use, or disclosure to third parties without express written authority is strictly forbidden. ABB Automation Inc. (US)

F-3BUA0980502-M, rev. 0 8-21-03

L	SEE ECN 10003203	06/23/09	DC	Description ACX550 Power Wiring Diagram	Project Name ACH550 PACKAGED DRIVE INPUT SWITCH AND FUSES	Approved D.Truettner	ABB Inc.		Reference number PD00R722PW-A	Sheet A
Rev	Description	Date	Appd			Checked J.Brenner			Document number 3AUA0000014954	Cont. B
Based On						Prepared Sch Gen	Resp. dept AJ	Date 9/19/2007		