



# SmartMod Digital Input/Output Module


HE359DIQ512

Four 12/24V DC Inputs (neg. logic)  
Four Relay Outputs (2A, max)





1 Specifications

DIQ512		DIQ512	
Inputs per Module (Commons)	4 (1 Common)	Sample Time (PLC Update Rate)	Min. 20mS - Determined by Communications w/OCS
Input Voltage Range	12/24 VDC	Terminal Type	Screw Type, Removable
Impedence	4.7k ohms	Storage Temp.	-40° to 85° Celsius
Peak Voltage	30 VDC	Operating Temp.	-10° to 60° Celsius
ON voltage level	10 VDC	Relative Humidity	5 to 95% Non-condensing
OFF voltage level	0-3 VDC	Dimensions WxHxD	17.5mm x 100mm x 120mm 0.69" x 3.94" x 4.72"
Outputs per Module	4 (2 SPDT, 2 SPST)	Weight	210g (8.4 oz.)
Max Switching Power	2A @ 250 VAC 2A @ 30 VDC	Communications	Modbus/RTU (binary) RS-485 half duplex
Minimum Load	5 VDC, 10mA	Factory Default Communications Parameters	38400 baud, N, 8, 1, no h/s Default Modbus ID 1
Maximum Voltage	250VAC, 110 VDC	Supported Modbus Commands	1,2,3,4,5,6,8, 15,16
Required Power (Steady State)	45mA @ 24Vdc, typical		
Required Power (Inrush)	Negligible		
Isolation	2000Vac for 60 seconds (Input/Power & Input/Comms)		
CE & UL Compliance	See Compliance Table at <a href="http://www.heapg.com/Pages/TechSupport/ProductCert.html">http://www.heapg.com/Pages/TechSupport/ProductCert.html</a>		

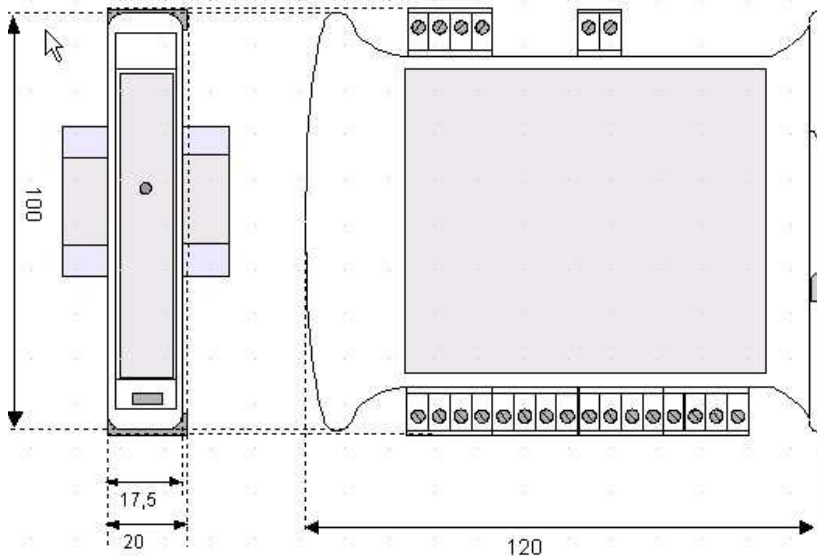


Dimensions in inches are 0.69"W x 3.95"H x 4.72"D  
Note: Number of I/O terminal connections vary from model to model


2 Wiring - I/O

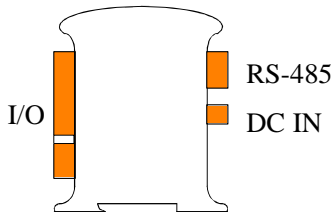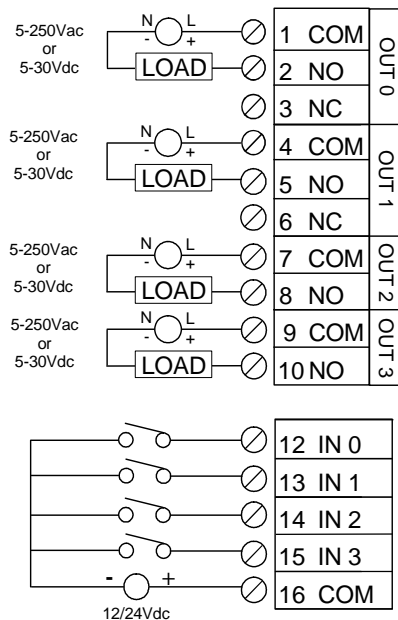

Pin #	DIQ512		Pin #	DIQ512	
1	COM	OUT 0	9	COM	OUT 3
2	N. O.		10	N.O.	
3	N. C.				
4	COM	OUT 1	12	INPUT 0	Note: Each Output COM isolated
5	N. O.		13	INPUT 1	
6	N. C.	OUT 2	14	INPUT 2	
7	COM		15	INPUT 3	
8	N.O.		16	COM	

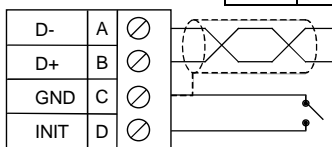

Wiring RS-485



Wiring DC IN


Notes:

Both ends of the RS-485 network should be terminated with a 100ohm, 1/4W, 1% resistor. Many OCS controllers feature dip switches or jumpers which enable appropriate termination if the OCS is located on a network end.

**3 Init Default Setup**

Communication parameters will be set to INIT default after performing the procedure:

1. Install jumper between INIT and GND terminals of the RS-485 port.
2. Apply power to Smartmod unit.
3. Read parameter words to see current parameters.
4. Write changes if necessary.



**The INIT Default RS485 Settings Are:**

Modbus ID = 1  
 Baud rate = 9600  
 Parity = None  
 Stop Bits = 1  
 Data Bits = 8  
 No handshake

**Note:** There are 2 types of default settings possible:  
 1. Factory default as described in section 1 (Specifications)  
 2. Default after INIT as described in section 3 (INIT Default Setup)

**4 Configuration DATA**

SmartMod Configuration settings are mapped into Modbus Register space. This configuration data may be modified with any Modbus/RTU Master device. For convenience, Horner APG has developed a variety of Cscape application files which allow an OCS (Xle, NX, LX, QX) to act as a SmartMod configurator. Initial configuration of SmartMod module should be done on an individual basis, since all modules come from the factory with a default Modbus ID of 1. Once each module on the network has its own unique Modbus ID, further configuration adjustments can be made with the entire network powered.

All configuration parameters listed below are stored in EPROM. That means they should not be constantly rewritten.

Configuration Parameters – Registers 40001 through 40013				
Modbus Register	Description	Min	Max	Default
40001-40005	Reserved			
40006	Communications Parameters	See Table		38.4kbau d, N, 8, 1, RTU Mode
40007	Modbus ID	1	255	1
40008	Rx/Tx Delay (in 2mS steps)	0	255	0mS
40009	Input Coils	Not Configuration Data – See I/O Data		
40010	Output Coils			
40011	Coils			
40012	Power Up/Safe	See Table		0
40013	Watchdog Timer *in 0.5s steps)	0	255	10(5 sec)

Register 40006 (Communications Parameters) Bit Definition							
Bits 15 - 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Unused	Mode	Parity		Data Bits	Baud Rate		
	0 = ASCII Mode	Value	Meaning	0 = 7 Data Bits	Value	Meaning	
		0	Mark		0	1200 baud	
		1	Even		1	2400 baud	
	1 = RTU Mode	2	Odd	1 = 8 Data Bits	2	4800 baud	
		3	Space		3	9600 baud	
					4	19200 baud	
					5-7	38400 baud	

Register 40012 (Power Up/Safe) Bit Definition									
Bit 15-12	Bit 11	Bit 10	Bit 9	Bit 8	Bit 4-7	Bit 3	Bit 2	Bit 1	Bit 0
Unused	Out 3	Out 2	Out 1	Out 0	Unused	Out 3	Out 2	Out 1	Out 0
	PowerUp Value					Safe Valve			

**5 Input/Output DATA**

SmartMod Digital I/O data utilizes both Modbus Registers (40009-40011) and Coils (1-35). It is possible to access all data using Registers only, because the Coils data can be accessed through Registers.

The following tables lists all Modbus I/O data available.

I/O Register Data (Registers 40009-40011)							
Modbus Register	Description	Access	Bits 1-8 & 13-16	Bit 12	Bit 11	Bit 10	Bit 9
40009	Mirror of Input Coil Data	Read-only	unused	In 3	In 2	In 1	In 0
40010	Mirror of Output Data	Read/Write	unused	Out 3	Out 2	Out 1	Out 0
40011	Mirror of WatchDog Data	Read/Write	unused	PwrUp Event	W.D.* Event	W.D.* Enbl	

\* W.D. - Watchdog

Modbus Coil	Description	Access	Watchdog Event & Power-up Event Operation
00001	Input 0	Read-only	If Coil 33 (Watchdog Enabled) is set, Coil 34 (Watchdog Event) will set if the Watchdog Timeout value is exceeded. The Watchdog Timeout value is set in Register 40013. When set, Coil 34 can be reset by the controller when normal communications resumes.
00002	Input 1	Read-only	
00003	Input 2	Read-only	
00004	Input 3	Read-only	
0005-00016	Reserved		The Power-up Event (Coil 35) is set every time the power is applied. It can be cleared by the controller if desired.
000017	Output 0	Read/Write	
000018	Output 1	Read/Write	
000019	Output 2	Read/Write	
000020	Output 3	Read/Write	
00021-00032	Reserved		
00033	Watchdog Enabled	Read/Write	
00034	Watchdog Event	Read/Write	
00035	Power-up Event	Read/Write	

**6 Installation / safety**

**Warning:** Remove power from the OCS controller, CAN port, and any peripheral equipment connected to this local system before adding or replacing this or any module.

- a. All applicable codes and standards should be followed in the installation of this product.
- b. Shielded, twisted-pair wiring should be used for best performance.
- c. Shields may be terminated at the module terminal strip.
- d. In severe applications, shields should be tied directly to the ground block within the panel.
- e. Use the following wire type or equivalent: Belden 8441.

For detailed installation and a handy checklist that covers panel box layout requirements and minimum clearances, refer to the hardware manual of the controller you are using.

When found on the product, the following symbols specify:



**7 Technical Support**

Technical Support at the following locations:

<b>North America:</b> Tel: 317 916-4274 Fax: 317 639-4279 Web: <a href="http://www.heapg.com">http://www.heapg.com</a> Email: <a href="mailto:techspt@heapg.com">techspt@heapg.com</a>	<b>Europe:</b> Tel: +353-21-4321266 Fax: +353-21-4321826 Web: <a href="http://www.horner-apg.com">http://www.horner-apg.com</a> Email: <a href="mailto:tech.support@horner-apg.com">tech.support@horner-apg.com</a>
--	---

No part of this publication may be reproduced without the prior agreement and written permission of Horner APG, Inc. Information in this document is subject to change without notice.