


| Transformer Specifications |             |
|----------------------------|-------------|
| PRIMARY VOLTAGE(S)         | 240/347/380 |
| SECONDARY VOLTAGE(S)       | 120X240     |
| RATED V.A.                 | 3000        |
| RATED FREQUENCY            | 50/60       |
| INSULATION CLASS           | 180         |
| AGENCY APPROVALS           | UL, CUL     |
| ESTIMATED WEIGHT           | 80.0 LBS    |

| TEST REQUIREMENTS         |                             |
|---------------------------|-----------------------------|
| WINDING                   | H4-H3-H2-H1 X4-X3 X2-X1     |
| D.C. VOLTS                | 239.4-347.1-380 123.0 123.0 |
| LOAD VOLTAGE              | 240-347-380 120 120         |
| FULL LOAD CURRENT (amps)  | 13.62/8.60 12.50 12.50      |
| HI POT WITHSTAND (kvolts) | 4800V 3000V                 |
| EXCITING AMPS             | 1.60A @ 380V@50Hz           |
| WATTS LOSS (watts)        | 110.0                       |

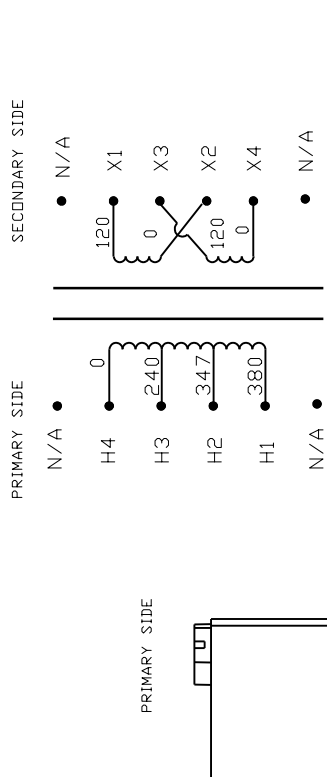

CONNECTION DIAGRAM

NOTE:  
1. ALL MEASUREMENTS IN INCHES (MM)


| PACKAGED ACCESSORIES |                   |
|----------------------|-------------------|
| 1                    | 1 PAIR OF JUMPERS |
| -                    | -                 |
| -                    | -                 |

**MICRON**  
CONTROL TRANSFORMERS  
800 664-4660  
UL LISTED 702X

**Impervitran**  
U.S. PAT. NO. 3578040  
3.0KVA 50/60HZ  
TEMP. CL. 180C  
CAT. B3K0-0324-3H

**MICRON INDUSTRIES CORPORATION**  
777 CHURCH ROAD, ELMHURST, IL 60126  
Tel: (608)664-4660 Fax: (608)664-1850  
www.microntransformers.com

|                 |                     |                   |    |         |  |          |
|-----------------|---------------------|-------------------|----|---------|--|----------|
| DATE            | 09/18/08            | DRAWN             | RN | CHECKED |  | APPROVED |
| RELEASE DATE    |                     | CUSTOMER PART NO. |    |         |  |          |
| MICRON PART NO. | B3K0-0324-3HB9999A0 |                   |    |         |  |          |
| SCALE           |                     |                   |    |         |  |          |
| SIZE            | C                   |                   |    |         |  |          |
| BY              |                     |                   |    |         |  |          |
| DATE            |                     |                   |    |         |  |          |

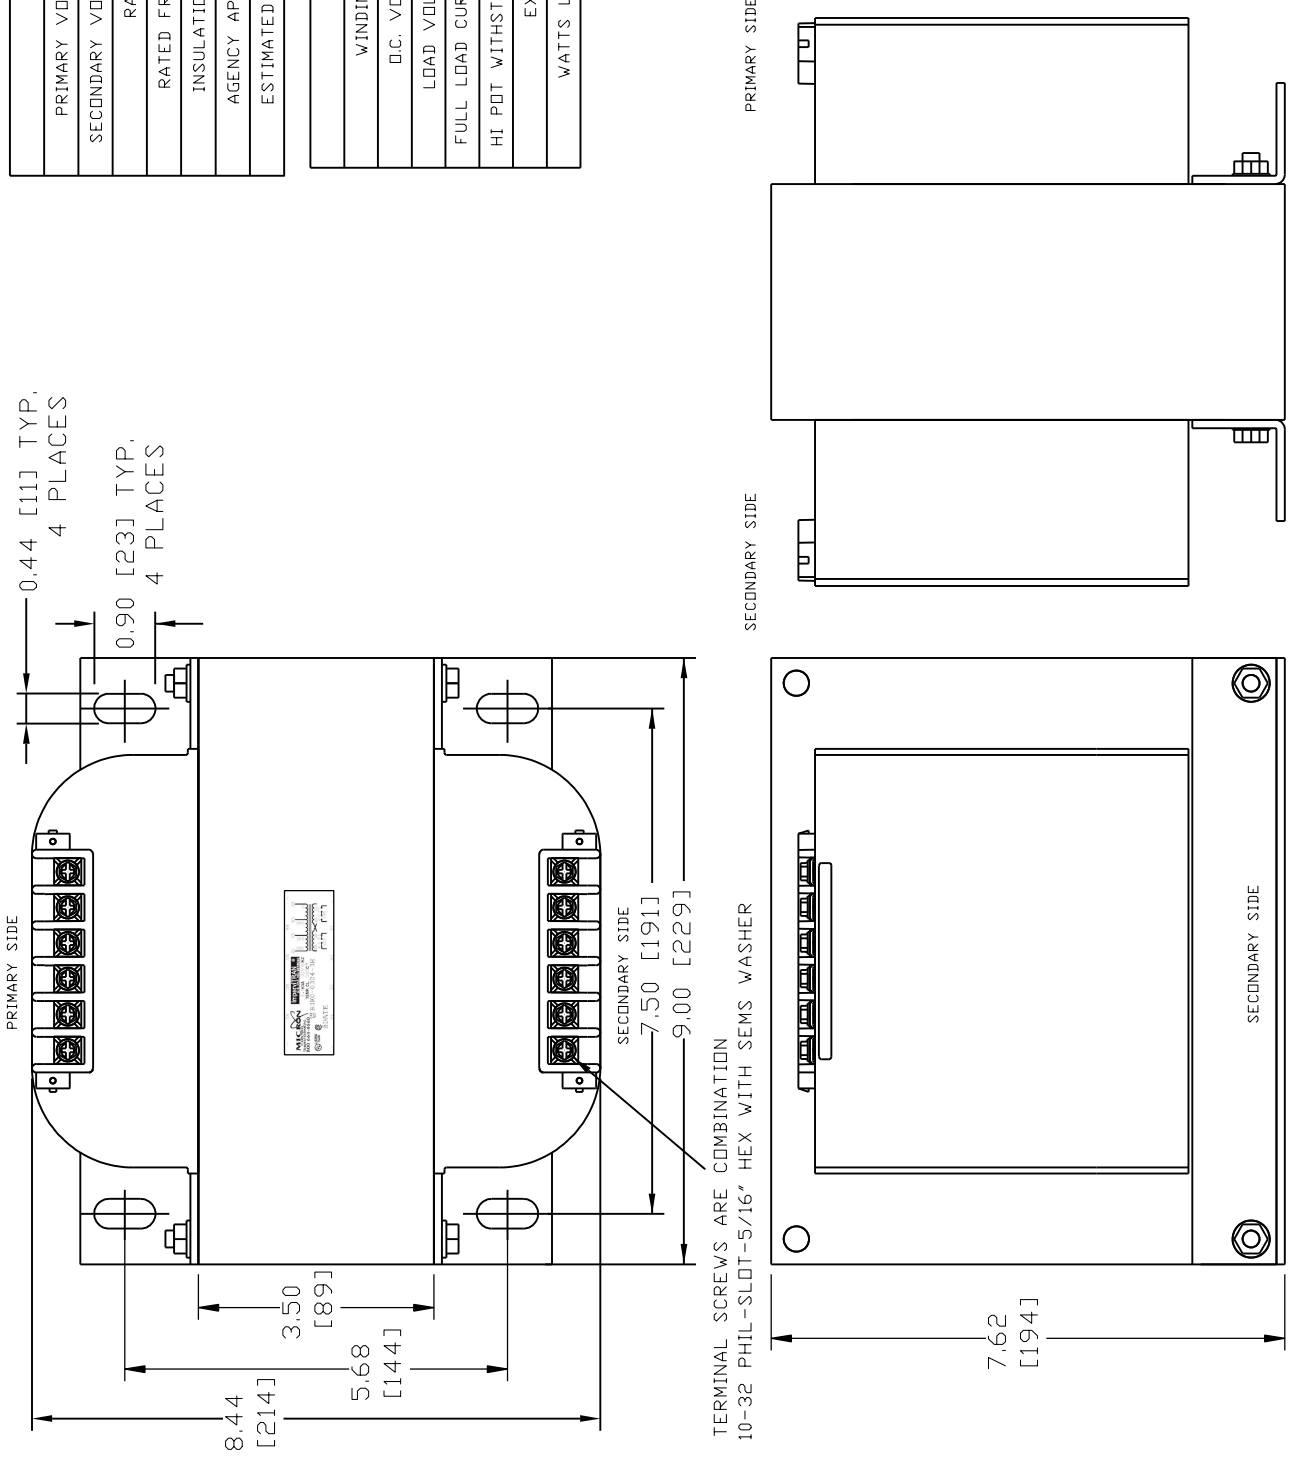

TERMINAL SCREWS ARE COMBINATION  
10-32 PHIL-SLOT-5/16" HEX WITH SEMS WASHER

| REVISIONS |                              |
|-----------|------------------------------|
| B         | SCREWS WERE 6" LONG AND 4231 |
| A         | FORMAT REVISED               |
| ECL       |                              |