

▶ PNOZ X3.1

PILZ
THE SPIRIT OF SAFETY

Operating Manual-20133-EN-09
- Safety relays



This document is the original document.

Where unavoidable, for reasons of readability, the masculine form has been selected when formulating this document. We do assure you that all persons are regarded without discrimination and on an equal basis.

All rights to this documentation are reserved by Pilz GmbH & Co. KG. Copies may be made for the user's internal purposes. Suggestions and comments for improving this documentation will be gratefully received.

Pilz®, PIT®, PMI®, PNOZ®, Primo®, PSEN®, PSS®, PVIS®, SafetyBUS p®, SafetyEYE®, SafetyNET p®, the spirit of safety® are registered and protected trademarks of Pilz GmbH & Co. KG in some countries.



SD means Secure Digital

| | |
|---|-----------|
| Introduction | 4 |
| Validity of documentation | 4 |
| Using the documentation | 4 |
| Definition of symbols | 4 |
| Safety | 5 |
| Intended use | 5 |
| Safety regulations | 5 |
| Safety assessment | 5 |
| Use of qualified personnel | 6 |
| Warranty and liability | 6 |
| Disposal | 6 |
| For your safety | 6 |
| Unit features | 7 |
| Safety features | 7 |
| Block diagram/terminal configuration | 7 |
| Function Description | 8 |
| Operating modes | 8 |
| Timing diagram | 9 |
| Installation | 9 |
| Wiring | 10 |
| Preparing for operation | 11 |
| Operation | 13 |
| Status indicators | 13 |
| Faults – Interference | 14 |
| Dimensions in mm | 14 |
| Technical details | 15 |
| Safety characteristic data | 20 |
| Supplementary data | 21 |
| Service life graph | 21 |
| Order reference | 22 |
| EC declaration of conformity | 22 |
| UKCA-Declaration of Conformity | 22 |

Introduction

Validity of documentation

This documentation is valid for the product PNOZ X3.1. It is valid until new documentation is published.

This operating manual explains the function and operation, describes the installation and provides guidelines on how to connect the product.

Using the documentation

This document is intended for instruction. Only install and commission the product if you have read and understood this document. The document should be retained for future reference.

Definition of symbols

Information that is particularly important is identified as follows:



DANGER!

This warning must be heeded! It warns of a hazardous situation that poses an immediate threat of serious injury and death and indicates preventive measures that can be taken.



WARNING!

This warning must be heeded! It warns of a hazardous situation that could lead to serious injury and death and indicates preventive measures that can be taken.



CAUTION!

This refers to a hazard that can lead to a less serious or minor injury plus material damage, and also provides information on preventive measures that can be taken.



NOTICE

This describes a situation in which the product or devices could be damaged and also provides information on preventive measures that can be taken. It also highlights areas within the text that are of particular importance.

**INFORMATION**

This gives advice on applications and provides information on special features.

Safety**Intended use**


The safety relay PNOZ X3.1 provides a safety-related interruption of a safety circuit.

The safety relay meets the requirements of EN 60947-5-1 and EN 60204-1 and may be used in applications with:

- ▶ E-STOP pushbuttons
- ▶ Safety gates

Improper use

The following is deemed improper use in particular

- ▶ Any component, technical or electrical modification to the product,
- ▶ Use of the product outside the areas described in this operating manual,
- ▶ Use of the product outside the technical details (see [Technical details](#)  15).

**NOTICE****EMC-compliant electrical installation**

The product is designed for use in an industrial environment. The product may cause interference if installed in other environments. If installed in other environments, measures should be taken to comply with the applicable standards and directives for the respective installation site with regard to interference.

Safety regulations**Safety assessment**

Before using a device, a safety assessment in accordance with the Machinery Directive is required.

The product as an individual component fulfils the functional safety requirements in accordance with EN ISO 13849 and EN 62061. However, this does not guarantee the functional safety of the overall plant/machine. To achieve the relevant safety level of the overall plant/machine's required safety functions, each safety function needs to be considered separately.

Use of qualified personnel

The products may only be assembled, installed, programmed, commissioned, operated, maintained and decommissioned by persons who are competent to do so.

A competent person is a qualified and knowledgeable person who, because of their training, experience and current professional activity, has the specialist knowledge required. To be able to inspect, assess and operate devices, systems and machines, the person has to be informed of the state of the art and the applicable national, European and international laws, directives and standards.

It is the company's responsibility only to employ personnel who

- ▶ Are familiar with the basic regulations concerning health and safety / accident prevention,
- ▶ Have read and understood the information provided in the section entitled Safety
- ▶ Have a good knowledge of the generic and specialist standards applicable to the specific application.

Warranty and liability

All claims to warranty and liability will be rendered invalid if

- ▶ The product was used contrary to the purpose for which it is intended,
- ▶ Damage can be attributed to not having followed the guidelines in the manual,
- ▶ Operating personnel are not suitably qualified,
- ▶ Any type of modification has been made (e.g. exchanging components on the PCB boards, soldering work etc.).

Disposal

- ▶ In safety-related applications, please comply with the mission time T_M in the safety-related characteristic data.
- ▶ When decommissioning, please comply with local regulations regarding the disposal of electronic devices (e.g. Electrical and Electronic Equipment Act).

For your safety

The unit meets all the necessary conditions for safe operation. However, please note the following:

- ▶ Note for overvoltage category III: If voltages higher than low voltage (>50 VAC or >120 VDC) are present on the unit, connected control elements and sensors must have a rated insulation voltage of at least 250 V.

Unit features


- ▶ Positive-guided relay outputs:
 - 3 safety contacts (N/O), instantaneous
 - 1 auxiliary contact (N/C), instantaneous
- ▶ 1 semiconductor output
- ▶ Connection options for:
 - E-STOP pushbutton
 - Safety gate limit switch
 - Start button
- ▶ LED display for:
 - Supply voltage
 - Switch state of the safety contacts
 - Input circuit
- ▶ Semiconductor output signals:
 - Switch state of the safety contacts
- ▶ See order reference for unit types

Safety features

The safety relay meets the following safety requirements:

- ▶ The circuit is redundant with built-in self-monitoring.
- ▶ The safety function remains effective in the case of a component failure.
- ▶ The correct opening and closing of the safety function relays is tested automatically in each on-off cycle.

Block diagram/terminal configuration

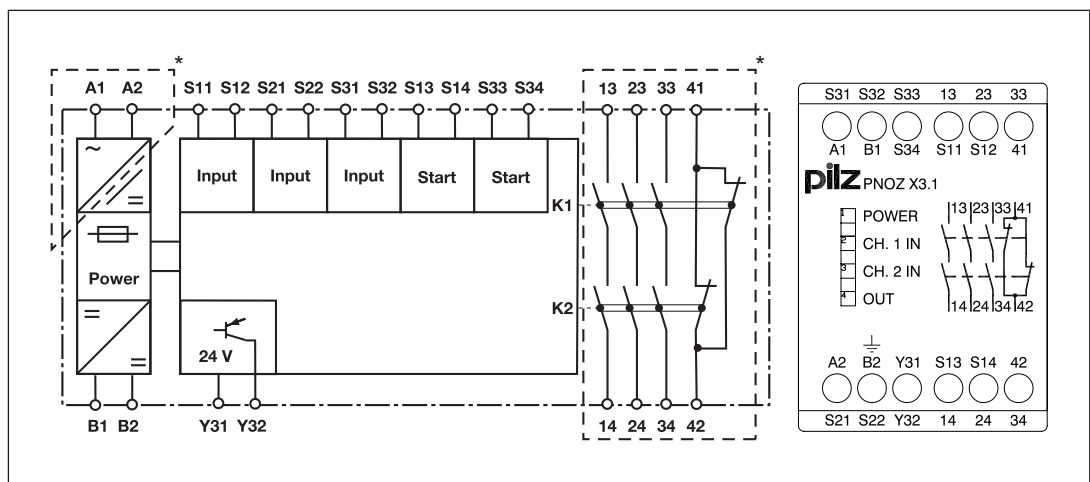

*Insulation between the non-marked area and the relay contacts: Basic insulation (over-voltage category III), Protective separation (overvoltage category II)

Function Description


The safety relay PNOZ X3.1 provides a safety-oriented interruption of a safety circuit. When supply voltage is supplied the "POWER" LED is lit. The unit is ready for operation when the start circuit S13-S14 is closed.

- ▶ Input circuit is closed (e.g. E-STOP pushbutton not operated):
 - The LEDs "CH.1 IN" and "CH.2 IN" are lit.
 - Safety contacts 13-14, 23-24 and 33-34 are closed, auxiliary contact 41-42 is open. The unit is active.
 - A high signal is present at the semiconductor output switch state Y32.
 - The "OUT" LED is lit.
- ▶ Input circuit is opened (e.g. E-STOP pushbutton operated):
 - The LEDs "CH.1 IN" and "CH.2 IN" go out.
 - Safety contacts 13-14, 23-24 and 33-34 are opened redundantly, auxiliary contact 41-42 is closed.
 - A low signal is present at the semiconductor output switch state Y32.
 - The "OUT" LED goes out.

Operating modes

- ▶ Single-channel operation: No redundancy in the input circuit, earth faults in the start and input circuit are detected.
- ▶ Dual-channel operation with detection of shorts across contacts: Redundant input circuit, PNOZ X3.1 detects
 - earth faults in the start and input circuit,
 - short circuits in the input circuit,
 - shorts across contacts in the input circuit.
- ▶ Automatic start: Unit is active once the input circuit has been closed.
- ▶ Monitored start: Unit is active once the input circuit is closed and once the start circuit is closed after the waiting period has elapsed (see [Technical details !\[\]\(448bd415caa8b52d2aeb4d58499267b2_img.jpg\) 15](#)).
- ▶ Increase in the number of available contacts by connecting contact expansion modules or external contactors/relays.

Timing diagram

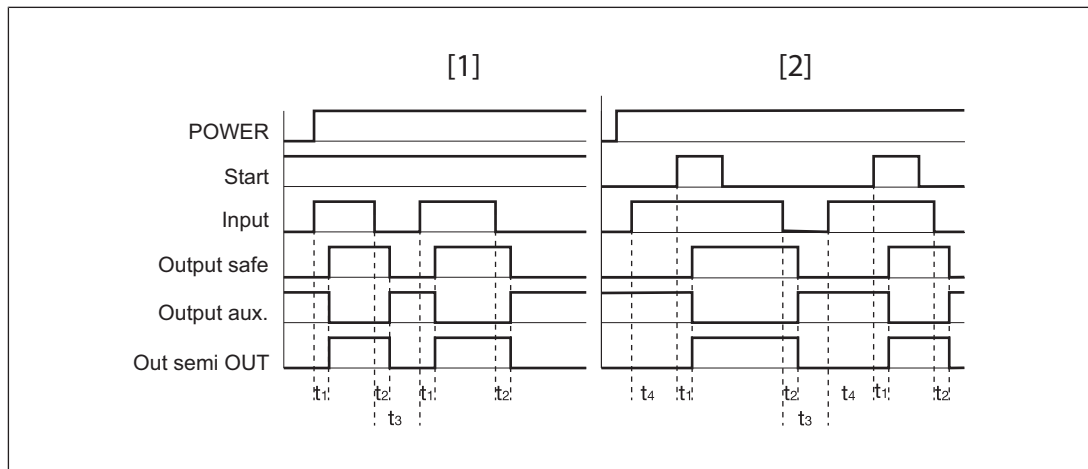

Legend

- ▶ Power: Supply voltage
- ▶ Start: Start circuit
- ▶ Input: Input circuit
- ▶ Output safe: Safety contacts
- ▶ Output aux.: Auxiliary contact
- ▶ Out semi OUT: Semiconductor output switch state
- ▶ [1]: Automatic start
- ▶ [2]: Monitored start
- ▶ t_1 : Switch-on delay
- ▶ t_2 : Delay-on de-energisation
- ▶ t_3 : Recovery time
- ▶ t_4 : Waiting period with a monitored start

Installation

- ▶ The unit should be installed in a control cabinet with a protection type of at least IP54.
- ▶ Use the notch on the rear of the unit to attach it to a DIN rail (35 mm).
- ▶ When installed vertically: Secure the unit by using a fixing element (e.g. retaining bracket or end angle).

Wiring

Please note:

- ▶ Information given in the "[Technical details \[15\]](#)" must be followed.
- ▶ Outputs 13-14, 23-24, 33-34 are safety contacts; output 41-42 is an auxiliary contact (e.g. for display).
- ▶ Auxiliary contact 41-42 should **not** be used for safety circuits!
- ▶ Delivery condition: Link between S11-S12 (dual-channel input circuit)
- ▶ To prevent contact welding, a fuse should be connected before the output contacts (see [Technical details \[15\]](#)).
- ▶ Calculation of the max. cable length l_{\max} in the input circuit:

$$l_{\max} = \frac{R_{l_{\max}}}{R_l / \text{km}}$$

$R_{l_{\max}}$ = max. overall cable resistance (see [Technical details \[15\]](#))

R_l / km = cable resistance/km

- ▶ Use copper wiring with a temperature stability of 60/75 °C.
- ▶ To prevent EMC interferences (particularly common-mode interferences) the measures described in EN 60204-1 must be executed. This includes the separate routing of cables of the control circuits (input, start and feedback loop) from other cables for energy transmission or the shielding of cables, for example.
- ▶ Do not switch low currents using contacts that have been used previously with high currents.
- ▶ Adequate protection must be provided on all output contacts with capacitive and inductive loads.
- ▶ When connecting magnetically operated, reed proximity switches, ensure that the max. peak inrush current (on the input circuit) does not overload the proximity switch.
- ▶ With a 24 VDC supply voltage via terminals B1, B2, the power supply must comply with the regulations for extra low voltages with safe electrical separation (SELV, PELV).
- ▶ When operated with AC voltage: Connect terminal B2 to the functional earth.

Important for detection of shorts across contacts:

As this function for detecting shorts across contacts is not failsafe, it is tested by Pilz during the final control check. If there is a danger of exceeding the cable length, we recommend the following test once the unit is installed:

1. Unit ready for operation (output contacts closed)
2. Short circuit the test terminals S22, S32 for detecting shorts across the inputs.
3. The unit's fuse must be triggered and the output contacts must open. Cable lengths in the scale of the maximum length can delay the fuse triggering for up to 2 minutes.
4. Reset the fuse: Remove the short circuit and switch off the supply voltage for approx. 1 minute.

Preparing for operation

| Supply voltage | AC | DC |
|---|----------------|--------------|
| | | |
| Input circuit | Single-channel | Dual-channel |
| E-STOP without detection of shorts across contacts | | |
| E-STOP with detection of shorts across contacts | | |
| Safety gate without detection of shorts across contacts | | |
| Safety gate with detection of shorts across contacts | | |



NOTICE

With single-channel wiring the safety level of your machine/plant may be lower than the safety level of the unit (see [Safety characteristic data](#) [20]).

| Start circuit | E-STOP wiring Safety gate without start-up test | Safety gate with start-up test |
|-----------------|--|--------------------------------|
| Automatic start | | |
| Monitored start | | |



NOTICE

In the event of an automatic start:

The unit starts up automatically when the safeguard is reset, e.g. when the E-STOP pushbutton is released. Use external circuit measures to prevent an unexpected restart.

| Feedback loop | Automatic start | Monitored start |
|-----------------------------------|-----------------|-----------------|
| Contacts from external contactors | | |

| Semiconductor output |
|----------------------|
| |

Legend

- ▶ S1/S2: E-STOP/safety gate switch
- ▶ S3: Reset button
- ▶ ⬆: Switch operated
- ▶ : Gate open
- ▶ : Gate closed

**INFORMATION**

With automatic start, S33 and S34 must not be linked; with monitored start, S13 and S14 must not be linked.

Operation

When the relay outputs are switched on, the mechanical contact on the relay cannot be tested automatically. Depending on the operational environment, measures to detect the non-opening of switching elements may be required under some circumstances.

When the product is used in accordance with the European Machinery Directive, a check must be carried out to ensure that the safety contacts on the relay outputs open correctly. Open the safety contacts (switch off output) and start the device again, so that the internal diagnostics can check that the safety contacts open correctly

- ▶ for SIL CL 3/PL e at least 1x per month
- ▶ for SIL CL 2/PL d at least 1x per year

**NOTICE**

The safety functions should be checked after initial commissioning and each time the plant/machine is changed. The safety functions may only be checked by qualified personnel.

Status indicators

LEDs indicate the status and errors during operation:



LED on

**POWER**

Supply voltage is present.

**CH.1 IN**

Channel 1 input circuit is closed.

**CH.2 IN**

Channel 2 input circuit is closed.


**OUT**

Safety contacts are closed and semiconductor output Y32 carries a high signal.

Faults – Interference

- ▶ Earth fault: The supply voltage fails and the safety contacts open. Once the cause of the respective fault has been rectified and the supply voltage is switched off for approx. 1 minute, the unit is ready for operation again.
- ▶ Contact malfunctions: If the contacts have welded, reactivation will not be possible after the input circuit has opened.
- ▶ LED "POWER" does not light: Short circuit or no supply voltage.

Dimensions in mm

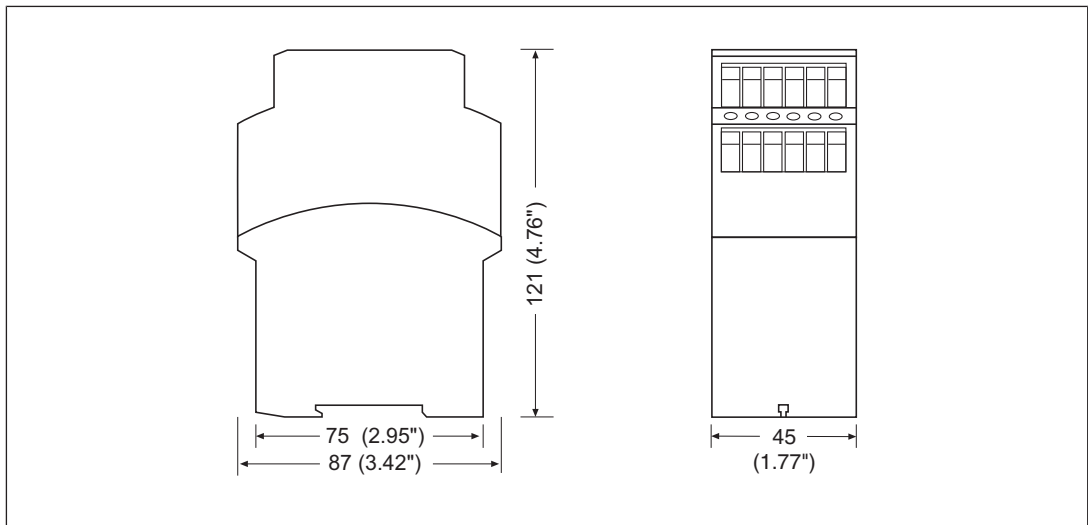

Technical details

| General | 774321 | 774322 |
|--|---------------------------------------|---------------------------------------|
| Certifications | CCC, CE, EAC, TÜV, UKCA, cULus Listed | CCC, CE, EAC, TÜV, UKCA, cULus Listed |
| Electrical data | 774321 | 774322 |
| Supply voltage | | |
| Voltage | 230 V | 240 V |
| Kind | AC | AC |
| Voltage tolerance | -15 %/+10 % | -15 %/+10 % |
| Output of external power supply (AC) | 5 VA | 5 VA |
| Frequency range AC | 50 - 60 Hz | 50 - 60 Hz |
| Supply voltage | | |
| Voltage | 24 V | 24 V |
| Kind | DC | DC |
| Voltage tolerance | -15 %/+10 % | -15 %/+10 % |
| Output of external power supply (DC) | 2,5 W | 2,5 W |
| Residual ripple DC | 160 % | 160 % |
| Duty cycle | 100 % | 100 % |
| Inputs | 774321 | 774322 |
| Quantity | 2 | 2 |
| Voltage at | | |
| Input circuit DC | 24 V | 24 V |
| Start circuit DC | 24 V | 24 V |
| Feedback loop DC | 24 V | 24 V |
| Current at | | |
| Input circuit DC | 50 mA | 50 mA |
| Start circuit DC | 35 mA | 35 mA |
| Feedback loop DC | 20 mA | 20 mA |
| Min. input resistance at power-on | 100 Ohm | 100 Ohm |
| Max. overall cable resistance R _I -max | | |
| Single-channel at UB DC | 150 Ohm | 150 Ohm |
| Single-channel at UB AC | 180 Ohm | 180 Ohm |
| Dual-channel with detection of shorts across contacts at UB DC | 15 Ohm | 15 Ohm |
| Dual-channel with detection of shorts across contacts at UB AC | 30 Ohm | 30 Ohm |
| Semiconductor outputs | 774321 | 774322 |
| Quantity | 1 | 1 |
| Voltage | 24 V | 24 V |
| Current | 20 mA | 20 mA |
| External supply voltage | 24 V | 24 V |
| Voltage tolerance | -20 %/+20 % | -20 %/+20 % |

| Semiconductor outputs | | |
|--|---------------------|---------------------|
| | 774321 | 774322 |
| Residual current at "0" signal | 0,1 mA | 0,1 mA |
| Max. internal voltage drop | 4 V | 4 V |
| Conditional rated short circuit current | 100 A | 100 A |
| Lowest operating current | 0 mA | 0 mA |
| Utilisation category in accordance with EN 60947-1 | DC-12 | DC-12 |
| Relay outputs | | |
| | 774321 | 774322 |
| Number of output contacts | | |
| Safety contacts (N/O), instantaneous | 3 | 3 |
| Auxiliary contacts (N/C) | 1 | 1 |
| Max. short circuit current I _K | 1 kA | 1 kA |
| Utilisation category | | |
| in accordance with the standard | EN 60947-4-1 | EN 60947-4-1 |
| Utilisation category of safety contacts | | |
| AC1 at | 240 V | 240 V |
| Min. current | 0,01 A | 0,01 A |
| Max. current | 8 A | 8 A |
| Max. power | 2000 VA | 2000 VA |
| DC1 at | 24 V | 24 V |
| Min. current | 0,01 A | 0,01 A |
| Max. current | 8 A | 8 A |
| Max. power | 200 W | 200 W |
| Utilisation category of auxiliary contacts | | |
| AC1 at | 240 V | 240 V |
| Min. current | 0,01 A | 0,01 A |
| Max. current | 8 A | 8 A |
| Max. power | 2000 VA | 2000 VA |
| DC1 at | 24 V | 24 V |
| Min. current | 0,01 A | 0,01 A |
| Max. current | 8 A | 8 A |
| Max. power | 200 W | 200 W |
| Utilisation category | | |
| in accordance with the standard | EN 60947-5-1 | EN 60947-5-1 |
| Utilisation category of safety contacts | | |
| AC15 at | 230 V | 230 V |
| Max. current | 5 A | 5 A |
| DC13 (6 cycles/min) at | 24 V | 24 V |
| Max. current | 6 A | 6 A |

| Relay outputs | 774321 | 774322 |
|--|--------------------------------------|--------------------------------------|
| Utilisation category of auxiliary contacts | | |
| AC15 at | 230 V | 230 V |
| Max. current | 5 A | 5 A |
| DC13 (6 cycles/min) at | 24 V | 24 V |
| Max. current | 6 A | 6 A |
| Utilisation category in accordance with UL | | |
| Voltage with current | 240 V AC G. P. 8 A | 240 V AC G. P. 8 A |
| Voltage with current | 24 V DC Resistive 5 A | 24 V DC Resistive 5 A |
| Pilot Duty | B300, R300 | B300, R300 |
| External contact fuse protection, safety contacts | | |
| in accordance with the standard | EN 60947-5-1 | EN 60947-5-1 |
| Max. melting integral | 240 A²s | 240 A²s |
| Blow-out fuse, quick | 10 A | 10 A |
| Blow-out fuse, slow | 6 A | 6 A |
| Blow-out fuse, gG | 10 A | 10 A |
| Circuit breaker 24V AC/DC, characteristic B/C | 6 A | 6 A |
| External contact fuse protection, auxiliary contacts | | |
| Max. melting integral | 240 A²s | 240 A²s |
| Blow-out fuse, quick | 10 A | 10 A |
| Blow-out fuse, slow | 6 A | 6 A |
| Blow-out fuse, gG | 10 A | 10 A |
| Circuit breaker, 24 V AC/DC, characteristic B/C | 6 A | 6 A |
| Contact material | AgSnO₂ + 0,2 µm Au | AgSnO₂ + 0,2 µm Au |
| Conventional thermal current while loading several contacts | 774321 | 774322 |
| I _{th} per contact at UB AC; AC1: 240 V, DC1: 24 V | | |
| Conv. therm. current with 1 contact | 8 A | 8 A |
| Conv. therm. current with 2 contacts | 7,5 A | 7,5 A |
| Conv. therm. current with 3 contacts | 6,5 A | 6,5 A |

| Conventional thermal current while loading several contacts | 774321 | 774322 |
|--|---|---|
| I _{th} per contact at UB DC; AC1: 240 V, DC1: 24 V | | |
| Conv. therm. current with 1 contact | 8 A | 8 A |
| Conv. therm. current with 2 contacts | 8 A | 8 A |
| Conv. therm. current with 3 contacts | 7 A | 7 A |
| Times | 774321 | 774322 |
| Switch-on delay | | |
| with automatic start typ. | 250 ms | 250 ms |
| with automatic start max. | 500 ms | 500 ms |
| with automatic start after power on typ. | 280 ms | 280 ms |
| with automatic start after power on max. | 550 ms | 550 ms |
| with monitored start typ. | 35 ms | 35 ms |
| with monitored start max. | 50 ms | 50 ms |
| Delay-on de-energisation | | |
| with E-STOP typ. | 15 ms | 15 ms |
| with E-STOP max. | 30 ms | 30 ms |
| with power failure typ. | 50 ms | 50 ms |
| with power failure max. | 70 ms | 70 ms |
| Recovery time at max. switching frequency 1/s | | |
| after E-STOP | 50 ms | 50 ms |
| after power failure | 100 ms | 100 ms |
| Waiting period with a monitored start | 300 ms | 300 ms |
| Min. start pulse duration with a monitored start | 30 ms | 30 ms |
| Supply interruption before de-energisation | 20 ms | 20 ms |
| Simultaneity, channel 1 and 2 max. | ∞ | ∞ |
| Environmental data | 774321 | 774322 |
| Climatic suitability | EN 60068-2-78 | EN 60068-2-78 |
| Ambient temperature | | |
| Temperature range | -20 - 55 °C | -20 - 55 °C |
| Storage temperature | | |
| Temperature range | -40 - 85 °C | -40 - 85 °C |
| Climatic suitability | | |
| Humidity | 93 % r. h. at 40 °C | 93 % r. h. at 40 °C |
| Condensation during operation | Not permitted | Not permitted |
| EMC | EN 60947-5-1, EN 61000-6-2, EN 61326-3-1 | EN 60947-5-1, EN 61000-6-2, EN 61326-3-1 |

| Environmental data | 774321 | 774322 |
|---|--|--|
| Vibration | | |
| in accordance with the standard | EN 60068-2-6 | EN 60068-2-6 |
| Frequency | 10 - 55 Hz | 10 - 55 Hz |
| Amplitude | 0,35 mm | 0,35 mm |
| Airgap creepage | | |
| in accordance with the standard | EN 60947-1 | EN 60947-1 |
| Overvoltage category | III / II | III / II |
| Pollution degree | 2 | 2 |
| Rated insulation voltage | 250 V | 250 V |
| Rated impulse withstand voltage | 4 kV | 4 kV |
| Protection type | | |
| Housing | IP40 | IP40 |
| Terminals | IP20 | IP20 |
| Mounting area (e.g. control cabinet) | IP54 | IP54 |
| Mechanical data | 774321 | 774322 |
| Mounting position | Any | Any |
| Mechanical life | 10,000,000 cycles | 10,000,000 cycles |
| Material | | |
| Bottom | PPO UL 94 V1 | PPO UL 94 V1 |
| Front | ABS UL 94 V0 | ABS UL 94 V0 |
| Top | PPO UL 94 V1 | PPO UL 94 V1 |
| Connection type | Screw terminal | Screw terminal |
| Mounting type | Fixed | Fixed |
| Conductor cross section with screw terminals | | |
| 1 core flexible | 0,2 - 4 mm², 24 - 10 AWG | 0,2 - 4 mm², 24 - 10 AWG |
| 2 core with the same cross section, flexible with crimp connectors, no plastic sleeve | 0,2 - 2,5 mm², 24 - 14 AWG | 0,2 - 2,5 mm², 24 - 14 AWG |
| 2 core with the same cross section, flexible without crimp connectors or with TWIN crimp connectors | 0,2 - 2,5 mm², 24 - 14 AWG | 0,2 - 2,5 mm², 24 - 14 AWG |
| Torque setting with screw terminals | 0,5 Nm | 0,5 Nm |
| Stripping length with screw terminals | 6 mm | 6 mm |
| Dimensions | | |
| Height | 87 mm | 87 mm |
| Width | 45 mm | 45 mm |
| Depth | 121 mm | 121 mm |
| Weight | 375 g | 375 g |

Where standards are undated, the 2022-09 latest editions shall apply.

Safety characteristic data



NOTICE

You must comply with the safety characteristic data in order to achieve the required safety level for your plant/machine.

| Operating mode | EN ISO 13849-1: 2015 | EN ISO 13849-1: 2015 | EN IEC 62061 SIL CL/ maximum SIL | EN IEC 62061 PFH _D [1/h] | EN/IEC 61511 SIL | EN/IEC 61511 PFD | EN ISO 13849-1: 2015 T _M [year] |
|----------------|----------------------|----------------------|----------------------------------|-------------------------------------|------------------|------------------|--|
| – | PL e | Cat. 4 | SIL 3 | 2,31E-09 | SIL 3 | 2,03E-06 | 20 |

Explanatory notes for the safety-related characteristic data:

- ▶ Safety characteristic data in accordance with EN IEC 62061 and EN/IEC 61511 was calculated based on EN/IEC 61508.
- ▶ T_M is the maximum mission time in accordance with EN ISO 13849-1. The value also applies as the retest interval in accordance with EN/IEC 61508-6 and EN/IEC 61511 and as the proof test interval and mission time in accordance with EN IEC 62061.

All the units used within a safety function must be considered when calculating the safety characteristic data.



INFORMATION

A safety function's SIL/PL values are **not** identical to the SIL/PL values of the units that are used and may be different. We recommend that you use the PAScal software tool to calculate the safety function's SIL/PL values.

Supplementary data




CAUTION!

It is essential to consider the relay's service life graphs. The relay outputs' safety-related characteristic data is only valid if the values in the service life graphs are met.

The PFH value depends on the switch frequency and the load of the relay output. If the service life graphs are not accessible, the stated PFH value can be used irrespective of the switch frequency and the load, as the PFH value already considers the relay's B10d value as well as the failure rates of the other components.

Service life graph

The service life graphs indicate the number of cycles from which failures due to wear must be expected. The wear is mainly caused by the electrical load; the mechanical load is negligible.

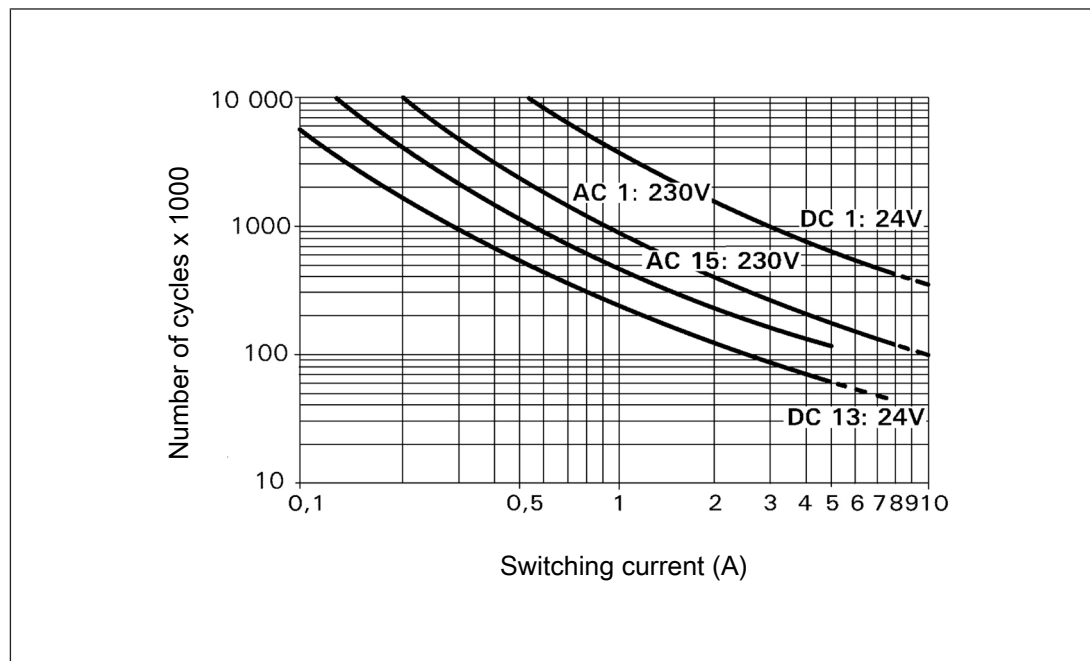

Example

- ▶ Inductive load: 0.2 A
- ▶ Utilisation category: AC15
- ▶ Contact service life: 4 000 000 cycles

Provided the application to be implemented requires fewer than 4 000 000 cycles, the PFH value (see Technical details) can be used in the calculation.

To increase the service life, sufficient spark suppression must be provided on all output contacts. With capacitive loads, any power surges that occur must be noted. With DC contactors, use flywheel diodes for spark suppression.

Order reference

| Product type | Features | Connection type | Order no. |
|--------------|-----------------|-----------------|-----------|
| PNOZ X3.1 | 230 VAC; 24 VDC | Screw terminals | 774321 |
| PNOZ X3.1 | 240 VAC; 24 VDC | Screw terminals | 774322 |

EC declaration of conformity

This product/these products meet the requirements of the directive 2006/42/EC for machinery of the European Parliament and of the Council. The complete EC Declaration of Conformity is available on the Internet at www.pilz.com/downloads.

Authorised representative: Norbert Fröhlich, Pilz GmbH & Co. KG, Felix-Wankel-Str. 2, 73760 Ostfildern, Germany

UKCA-Declaration of Conformity

This product(s) complies with following UK legislation: Supply of Machinery (Safety) Regulation 2008.

The complete UKCA Declaration of Conformity is available on the Internet at www.pilz.com/downloads.

Representative: Pilz Automation Technology, Pilz House, Little Colliers Field, Corby, Northamptonshire, NN18 8TJ United Kingdom, eMail: mail@pilz.co.uk

